

TriaAir[®]

Ventilationsanlæg

Tekniske data

J Prime 25_09, ROTOR



Varenr.: Q00950150
Med ROTOR

Standardfarve: RAL 9002 glans 30 (hvid)



TECHNICAL DATA			
Date	21.08.2020	Rev. Date	07.09.2020
Project ID	4157	Tracking Number	4126
Project Name	Itemnr. Q00950150		
AHU Name	J Prime_25_09		
AHU Model	JUPITER 8 X 8		




Ecodesign Requirements Table



	Value			2018
Product	JUPITER 25			
Erp	2018			
A Manufacturer	BSK Havalandırma Ekipmanları A.Ş.			
B Model Identifier	JUPITER 8 X 8			
C ErP Code	NRVU - BVU			
D Type Of Drive	Variable Speed Drive (VSD)In	Variable Speed Drive (VSD)Out		Required
E Type Of HRS	Rotary			
HRS Damper	Exists			Exists Required
F Thermal Efficiency of HRS	82,01 %			82,01 % >= 73 %
G Nominal Flow Rate	0,25 m³/s	0,25 m³/s		
H Effective Electrical Power Input	0,22 kW	0,23 kW	0,45 kW	
I SFPInt	485 W/(m³/s)	439 W/(m³/s)	924W/(m³/s)	<= 1333
J Face Velocity	1,11 m/s	1,04 m/s		
K Nominal External Drop Δps, Ext	150 Pa			150 Pa
L Internal Pressure Drop Δps, Int Supply Air	247 Pa			247 Pa
Internal Pressure Drop Δps, Int Exhaust Air	273 Pa			273 Pa
M Additional Pressure Drop Δps, Add	30 Pa	30 Pa		
N Static Fan Efficiency EC327/2011	49,75 %	50,11 %		
O Declared Maximum Ext./Int. Leakage Rate	1,00 %			1,00 %
Leakage Classifications by Eurovent	L1			L1
P Energy Performance Of Filters	A	A		
Q Description Of Visual Filter Warning	Manometer Pressure Gauge	Manometer Pressure Gauge		Required
R Casing Sound Power Level (Lwa)	50,8 dBA			50,8 dBA
S Internet Address Of Instructions	www.Termicplus.dk			
Total Dimension mm	W 710 x H 1015 x L 1510			
Supply Airflow	900 m³/h			900 m³/h
Return Airflow	900 m³/h			900 m³/h
Design Outdoor Temp. Summer	(+25,8°C) (Hum. 60%)			(+25,8°C)
Design Outdoor Temp. Winter	(-12 °C) (Hum. 90%)			(-12 °C)
FRESH AIR CONNECTION Air Velocity	2,08 m/s			2,08 m/s
SUPPLY CONNECTION Air Velocity	2,08 m/s			2,08 m/s
RETURN CONNECTION Air Velocity	4 m/s			4 m/s
EXHAUST CONNECTION Air Velocity	2,08 m/s			2,08 m/s
Total Heating Capacity				
Fluid Kind for Heating				
Fluid Temp. In / Out (Heating)				
Total Cooling Capacity				
Fluid Kind for Cooling				
Fluid Temp. In / Out (Cooling)				
Filter Type supply Air	F7 Panel			F7 Panel
Filter Type Return Air	M6 Panel			M6 Panel
Total Weight	322 kg			322 kg

Accessories	Connection possible (Motherboard)	Included in the unit	Overall Total values
Co2 sensor	Yes	No	
Motion Sensor	Yes	No	
Heating Module	Yes	No	
Cooling Module	Yes	No	
Hood for supply air	Yes	No	
Hood for Exhaust air	Yes	No	
VAV	Yes	No	
Heating coil valve	Yes	No	
Cooling coil valve	Yes	No	
Electric Pre-heater	Yes	No	
Electric Heater	Yes	No	
Fire/smoke Automatic	Yes	No	
Steam Humidifier (M7)	Yes	No	
Prepared to fire	Yes	No	
Prepared to Smoke	Yes	No	
Motherboard/Display	Yes	Yes	
Kitchen Unit	Yes	No	
Unit Used as a smoke fan	Yes	No	

Air Flow 25_09

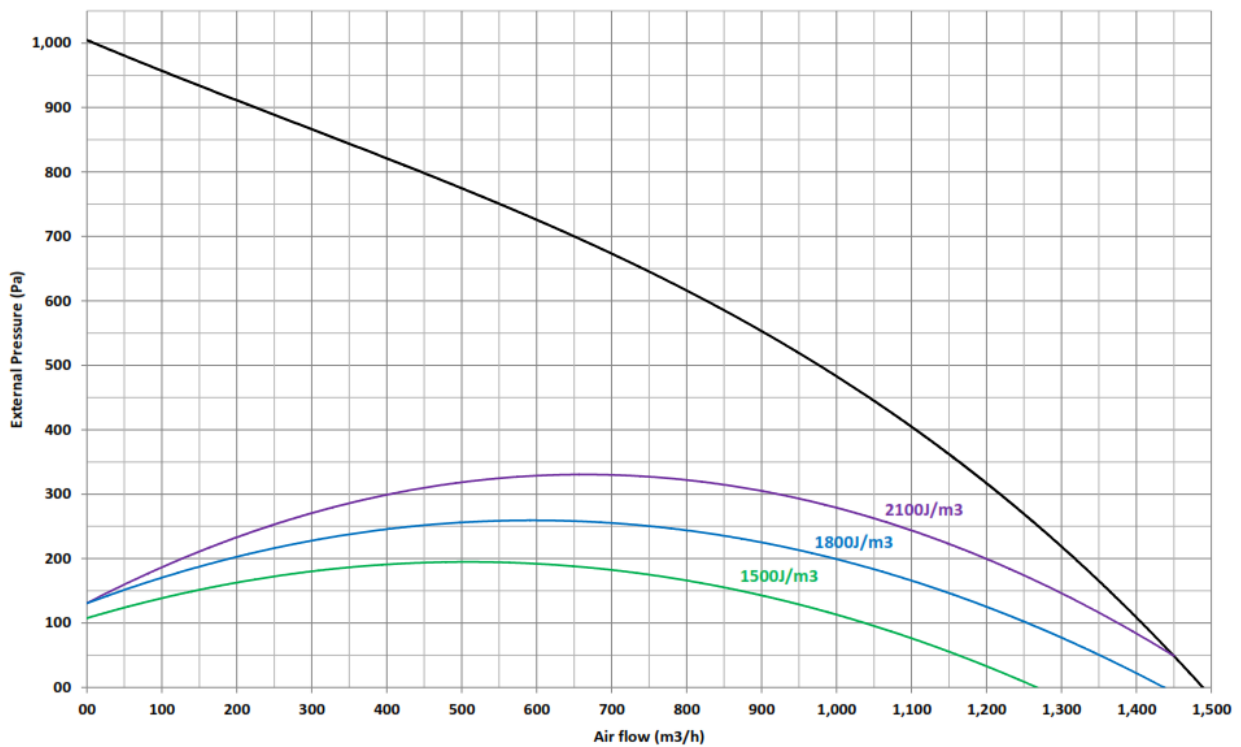

Efficiency Jprime 25_09

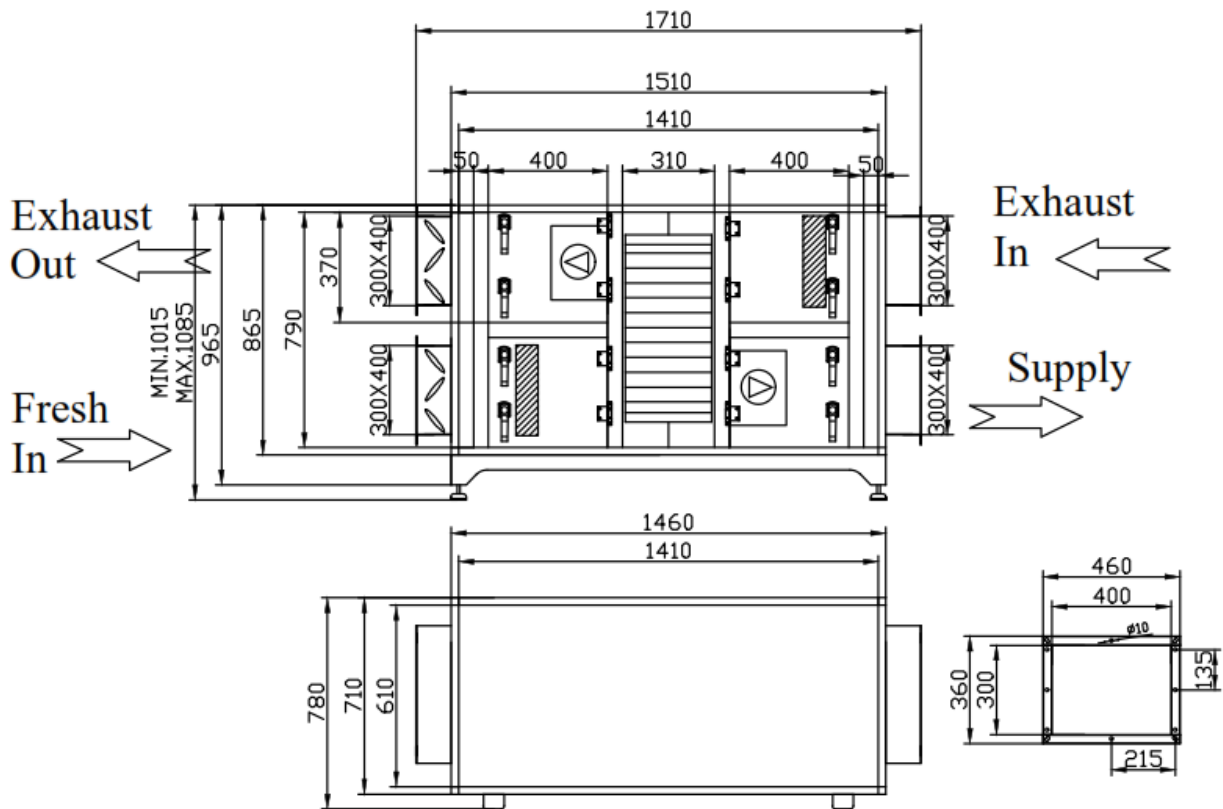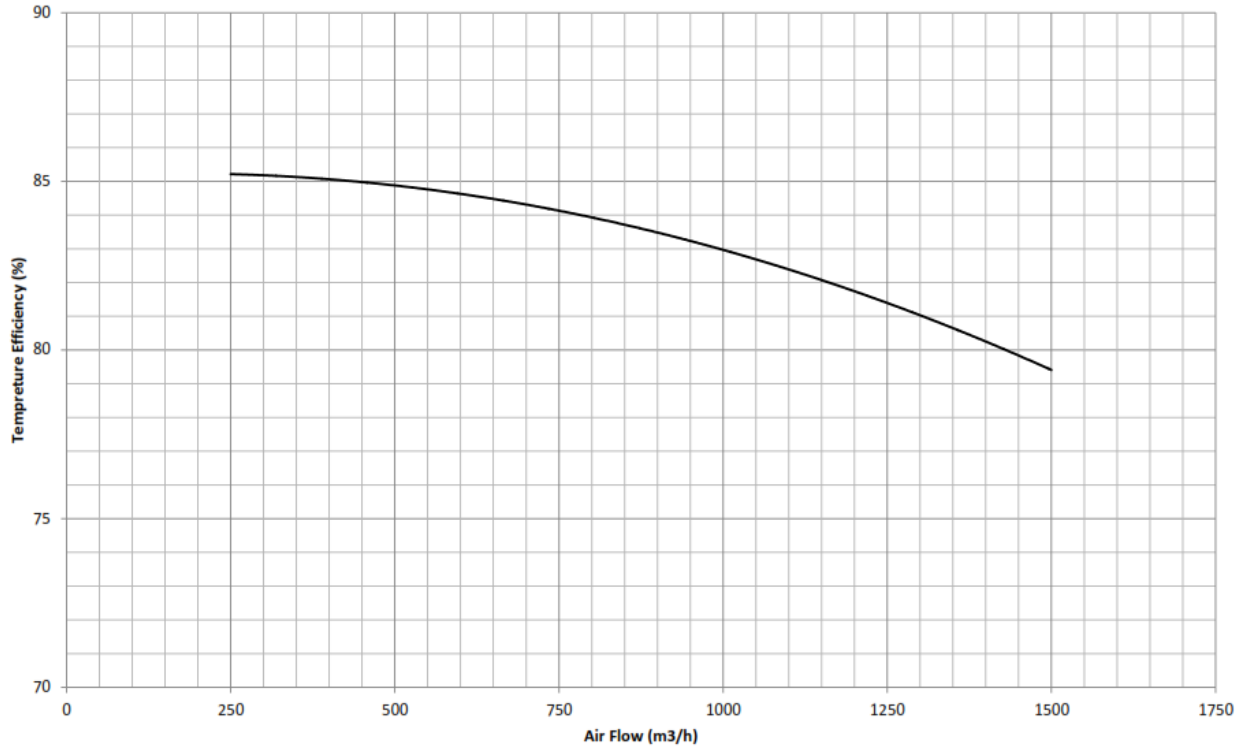

NOTE: ALL DIMENSIONS ARE MM



ATTESTATION OF CONFORMITY UYGUNLUK ONAYI

Sertifika Numarası / Certificate Number : M.2020.ST.1195.01

Üretici <i>Manufacturer</i>	: BSK Havalandırma Ekipmanları Anonim Şirketi
Üretici Adresi <i>Manufacturer adress</i>	: Mimar Sinan Mah. Basra Cad. No:59 Sultanbeyli İSTANBUL / TÜRKİYE
Ürün Tanımı <i>Product description</i>	: Klima Santrali Standart&Hygienic Air Handling Units
Tip / Model <i>Type / Model</i>	: BSK JUPITER Serisi: 500m ³ /h - 100.000m ³ /h
İlgili Yönetmelikler <i>Related Directives</i>	: 2006/42/AT Makina Emniyeti Yönetmeliği/EK VIII 2006/42/EC Machinery Directive/Annex VIII
İlgili Standartlar <i>Related Standards</i>	: EN ISO 12100,EN ISO 14120,EN ISO 13849-1, EN 60204-1
Denetim Raporu <i>Audit Report</i>	: ST.1195.01

UDEM Adriatic d.o.o. adı ve adresi yukarıda belirtilen firmanın sunduğu teknik dokümanları inceleyerek, belirlenen ürünün Makina Emniyeti Yönetmeliği 2006/42/AT Ek VIII kurallarına uygunluğunu onaylar. Yukarıda belirtilen tiplerdeki ürün üzerine CE işaretini, üreticinin kendi sorumluluğunda hazırlayacağı AT Uygunluk Beyanı ile iliştirebilir. İncelemesi yapılan ürüne ait olan bu belge tasarımın değişmesi halinde geçerliliğini yitirecektir. Bu belgenin geçerliliğini www.udemadriatic.com internet sayfasından kontrol edebilirsiniz. Bu belge sadece yukarıda adı geçen ürün tip/modelleri için geçerlidir. Yukarıda adı geçen firma ve UDEM bu belgelerin bir kopyasını tescil tarihinden itibaren 15 yıl süreyle muhafaza etmelidir. Bu belgenin mülkiyet hakkı UDEM Adriatic d.o.o 'ya aittir ve istenildiğinde iade edilmelidir.

UDEM Adriatic d.o.o. confirms by examining technical documents presented on the part of company which stated title and address below that product is conformable to 2006/42/EC Annex VIII



Machinery Directive regulations, could attach marking on the product with EC Declaration of Conformity prepared by manufacturer in the charge of company. In case of changing this certificate design regarding to product examined, certificate will be expired. Please check validity of this certificate by website www.udemadriatic.com This certificate is valid just for the product type/models stated below. UDEM and Company above mentioned must retain a copy of these certificates for 15 years since the day of registration. This certificate property belongs to UDEM Adriatic d.o.o and if required it must be returned.

Yayın Tarihi / Issue Date : 29.09.2020

Geçerlilik Tarihi / Validity date : 28.09.2021



Udem Adriatic d.o.o

Adres: Radnička cesta 54/R3, Zagreb Croatia

Tel: +385 (1) 4819 601 Faks: +385 (1) 4819 434

E-posta: info@udemadriatic.com Web: www.udemadriatic.com

EC DECLARATION OF CONFORMITY / AT UYGUNLUK BEYANI



We herewith declare / İş bu beyanname ile



BSK HAVALANDIRMA EKİPMANLARI ANONİM ŞİRKETİ

Address: Mimar Sinan Mah. Basra Cad. No:59 Sultanbeyli İSTANBUL / TURKEY

Product Name: Standart&Hygienic Air Handling Units

Model: BSK JUPITER Serisi:500m3/h - 100.000m3/h

Year of Manufacture/ Serial Number: 2020/001

Regulations Applied

We declare that we meet the following directive conditions for the Air Handling Unit that we have assembled and manufactured.

- 2006/42/EC Machinery Directive/Annex VIII

Application Standard

- EN ISO 12100
- EN ISO 14120
- EN ISO 13849-1
- EN 60204-1

Date and Place of Declaration : 28.09.2020/İSTANBUL

Name and Surname :

Deniz Palat

Signature, Stamp




Address/Adres: Mimar Sinan, Basra Cad. No:59 Sultanbeyli / İstanbul

Phone / Telefon: : + 90 216 669 09 70

Mail: info@bskhavalandirma.com


Web : www.bskhavalandirma.com

DECLARATION OF CONFORMITY


	TECHNICAL DATA			
	Date	21.08.2020	Rev. Date	07.09.2020
	Project ID	4157	Tracking Number	4126kopya
	Project Name	25secim		
AHUSEL V.	2.2.3.17 15.08.2020	AHU Name		J Prime_25_09 - (1 QTY)
BSK	1/6	AHU Model		JUPITER 8 X 8



RIGHT VIEW

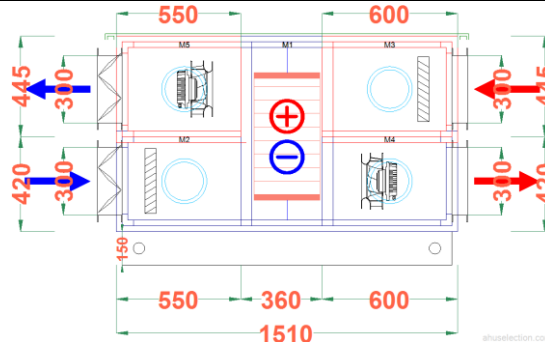

TOP VIEW

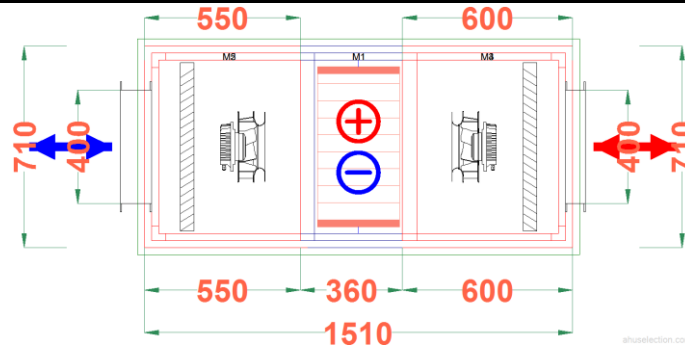

GENERAL SPECIFICATIONS

Supply Air Flow	Return Air Flow	Frame	Total Dimensions mm	
900 m³/h	900 m³/h	25 steel profile	W 710 x H 1.015 x L 1.510	
Supply Air Velocity	Return Air Velocity	Insulation Material	Total Weight	
1,19 m/s	1,11 m/s	50 mm Rockwool 70 kg/m³	322 kg	
	Air Density	Outside Sheet Material	Base Height	Roof (Outside)
	1,3504 kg/m³	0,9 mm Painted Galvanize	150 mm	Sheet
Design Outdoor Temp.(W-S)		Inside Sheet Material	Total Absorbed Power	
(-12°C/90%)-(25,80°C/60%) (Odense)		0,9 mm Galvanize	0,44 kW	
		Total Sensible Capacity	Motor Power(Vent/Asp)	
			0,39 kW / 0,39 kW	
Specific Fan Power(SFP Total)	ErP Compliance	ErP Code	Real Unit CAL Class -400 Pa	Real Unit CAL Class +400 Pa
0,93 kW/(m³/s)	2018	NRVU - BVU	L1	L2

SOUND POWER LEVEL (dB)

Frequency Hz	125	250	500	1000	2000	4000	8000	LwA-tot	
Airborne Sound Power Level	59,2	53,7	50,7	41,6	36,1	28,2	11,8	50,7	dBA
Air Outlet Induct Sound Power Level	71,7	75,2	75,4	72,6	65,8	61,6	54,1	76,1	dBA
Air Inlet Induct Sound Power Level	67,2	61,6	60,0	55,2	46,6	37,2	27,4	60,5	dBA
Return Air Outlet Induct Sound Power Level	72,2	76,0	76,2	73,2	66,2	62,1	54,6	76,2	dBA
Return Air Inlet Induct Sound Power Level	67,8	62,4	60,8	55,8	46,9	37,6	27,8	61,3	dBA

ACCESSORIES




Lightening, Observation Glass, Manometer Pressure Gauge


Model	CS Class	CAL Class -400 Pa	CAL Class +700 Pa	FBL Class	TT Class	TBF Class	Casing acoustical insulation at 125 Hz [dB]	Casing acoustical insulation at 250 Hz [dB]	Casing acoustical insulation at 500 Hz [dB]	Casing acoustical insulation at 1000 Hz [dB]	Casing acoustical insulation at 2000 Hz [dB]	Casing acoustical insulation at 4000 Hz [dB]	Casing acoustical insulation at 8000 Hz [dB]
JUPITER	D2	L1	L1	F9	T2	TB2	18,4	27,2	30,1	35,4	33,3	36,5	43,9

*These results obtained according to Eurovent modelbox test.

www.bskhavalandirma.com.tr	Office Tel:	+90 216 669 09 70	Factory Tel:	+90 216 669 09 70
info@bskhavalandirma.com.tr	Office Fax:	+90 216 669 09 72	Factory Fax:	+90 216 669 09 72



		TECHNICAL DATA				
		Date	21.08.2020	Rev. Date	07.09.2020	
		Project ID	4157	Tracking Number	4126kopya	
		Project Name	25secim			
AHUSEL V.	2.2.3.17 15.08.2020	AHU Name	J Prime_25_09 - (1 QTY)			
BSK	2/6	AHU Model	JUPITER 8 X 8			
FRESH AIR CONNECTION						
Connection Type		Control Type		Pressure Drop		
Gear Damper		Automatic (LM230ASR)		0 Pa		
Airflow		Dimensions		Air Velocity		
900 m³/h		W 400 mm x H 300 mm		2,08 m/s		
SUPPLY CONNECTION						
Connection Type		Control Type		Pressure Drop		
Flange				0 Pa		
Airflow		Dimensions		Air Velocity		
900 m³/h		W 400 mm x H 300 mm		2,08 m/s		
RETURN CONNECTION						
Connection Type		Control Type		Pressure Drop		
Flange				0 Pa		
Airflow		Dimensions		Air Velocity		
900 m³/h		W 400 mm x H 300 mm		4 m/s		
EXHAUST CONNECTION						
Connection Type		Control Type		Pressure Drop		
Gear Damper		Automatic (LM230ASR)		0 Pa		
Airflow		Dimensions		Air Velocity		
900 m³/h		W 400 mm x H 300 mm		2,08 m/s		
FILTER (M2)						
Airflow	Condensation Pan			Spare Filter	Section Weight	
900 m³/h					67 kg	
Filter Type	Initial / Final / Design P.Drop	Air Velocity	Size/Quantity/EC*	Size/Quantity/EC*	Size/Quantity/EC*	Size/Quantity/EC*
F7 Panel	18 Pa / 54 Pa / 36 Pa	1,47 m/s	592x287x48/1/A			
* Filter Energy Performance; preferably energy classification						
* Frame sealing applied.						
ACCESSORIES (M2)						
Lightening, Observation Glass, Manometer Pressure Gauge						


	TECHNICAL DATA			
	Date	21.08.2020	Rev. Date	07.09.2020
	Project ID	4157	Tracking Number	4126kopya
	Project Name	25secim		
AHUSEL V.	2.2.3.17 15.08.2020	AHU Name	J Prime_25_09 - (1 QTY)	
BSK	3/6	AHU Model	JUPITER 8 X 8	



ROTARY HEAT EXCHANGER (M1)

Model	Rpm	Quantity	Section Weight
RRU_ECO-P-E14-565/565-515	15	1	70 kg

	Fresh Air	Exhaust	Capacity	Winter	Summer				
Airflow	900 m³/h	900 m³/h		12,53 kW	-0,43 kW				
Air Vel.	2,13 m/s	2,44 m/s		Fresh	Exhau	Fresh	Exhaus		
	Winter		Summer	P.D	182 Pa	216 Pa	231 Pa	216 Pa	
	Effic.	Balan.(*)	Effic.	Balan.(*)	1.2kg/m³	224 Pa	212 Pa	224 Pa	212 Pa
	82,01	82,01	78,82	78,82					
Air Inlet / Outlet	Winter				Summer				
	Fresh Air		Exhaust		Fresh Air		Exhaust		
	Inlet	Outlet	Inlet	Outlet	Inlet	Outlet	Inlet	Outlet	
	DT	-12,00 °	17,52 °C	24,00 °C	-1,94 °C	25,80 °C	24,38 °C	24,00 °C	25,42 °C
WT	-12,00 °	11,63 °C	17,07 °C	-2,20 °C	18,55 °C	18,08 °C	17,07 °C	17,56 °C	
RH	100,00	49,06 %	50,00 %	95,00 %	50,00 %	54,41 %	50,00 %	45,93 %	

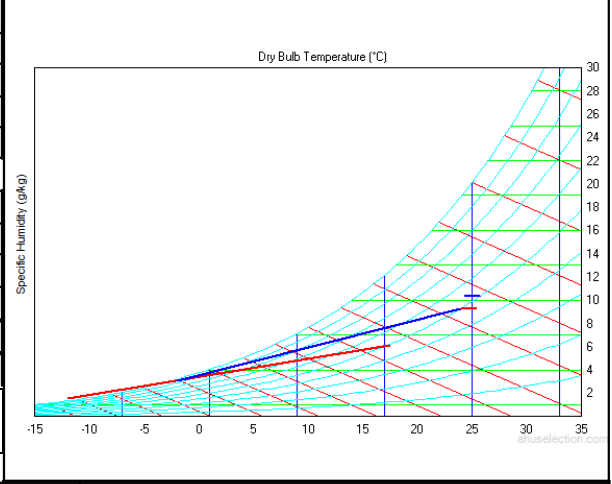




Condensation Pan	OACF (*)	EATR (%) (*)
	0,00	0,00

<input type="checkbox"/> Frequency Inverter	Size mm (565 x 565 x 290) - 515	Bypass Damper
---	------------------------------------	---------------


* Efficiency at balanced flow
* OACF: Outdoor Air Correction Factor, EATR: Exhaust Air Transfer Ratio

ACCESSORIES (M1)



	TECHNICAL DATA				
	Date	21.08.2020	Rev. Date		07.09.2020
	Project ID	4157	Tracking Number		4126kopya
	Project Name	25secim			
AHUSEL V.	2.2.3.17 15.08.2020	AHU Name		J Prime_25_09 - (1 QTY)	
BSK	4/6	AHU Model		JUPITER 8 X 8	

SUPPLY FAN (M4)

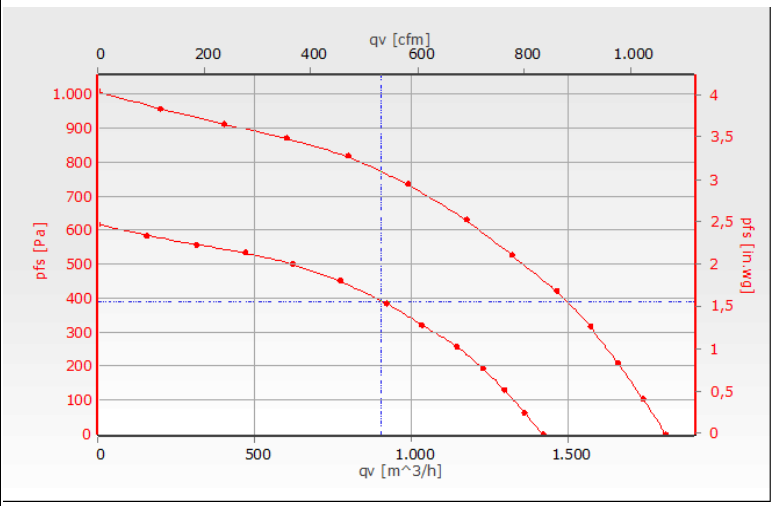Airflow	900 m³/h	Fan Model	EBM Papst-R3G250RO0671			Quantity	1	Section Weight	68 kg			
Internal Static Pressure	244 Pa	Motor P./Pha./Volt./Freq.	0,39 kW/1P/230V/50-60Hz			Isolator		Isolator Count				
External Static Pressure	150 Pa				Backup Fan		Backup Motor					
Total Static Pressure	394 Pa											
Total Pressure	424 Pa											
System Effect	26 Pa											
Total / Static Efficiency	53,53 / 49,70 %											
Shaft Power / Absorbed Power	0,2 / 0,22 kW											
Fan Speed	2658 rpm (Max.3400 rpm)	Absorbed Pow.With VFD	0,22 kW									
	Air Density	1,2000 kg/m³										
Specific Fan Power (SFP _e int)	0,49 kW/(m³/s)	Sound Power Level (dB)										
Electrical Current	0,94 A (Max.1,84 A)	Hz	63	125	250	500	1000	2000	4000	8000	LwA-tot	
		SPLm - Outlet Side	69,2	66,5	68,4	71,5	72,6	67,8	64,2	56,9	75,8	dBA
		SPLa - Inlet Side	64,2	61,5	63,4	66,5	67,6	62,8	59,2	51,9	70,8	dBA

* The fan system effect is taken into account in the fan performance
 * The fan calculated for wet conditions
 * Sfp is calculated based on clean filter & dry coil conditions

ACCESSORIES (M4)


Lightening, Observation Glass	
-------------------------------	---



FILTER (M3)

Airflow	900 m³/h	Condensation Pan				Spare Filter		Section Weight	59 kg
Filter Type	M6 Panel	Initial / Final / Design P.Drop	12 Pa / 36 Pa / 24 Pa	Air Velocity	1,47 m/s	Size/Quantity/EC*	592x287x48/1/A	Size/Quantity/EC*	


* Filter Energy Performance; preferably energy classification
 * Frame sealing applied.

ACCESSORIES (M3)

Lightening, Observation Glass, Manometer Pressure Gauge	
---	---

	TECHNICAL DATA				
	Date	21.08.2020	Rev. Date		07.09.2020
	Project ID	4157	Tracking Number		4126kopya
	Project Name	25secim			
AHUSEL V.	2.2.3.17 15.08.2020	AHU Name		J Prime_25_09 - (1 QTY)	
BSK	5/6	AHU Model		JUPITER 8 X 8	

EXHAUST FAN (M5)

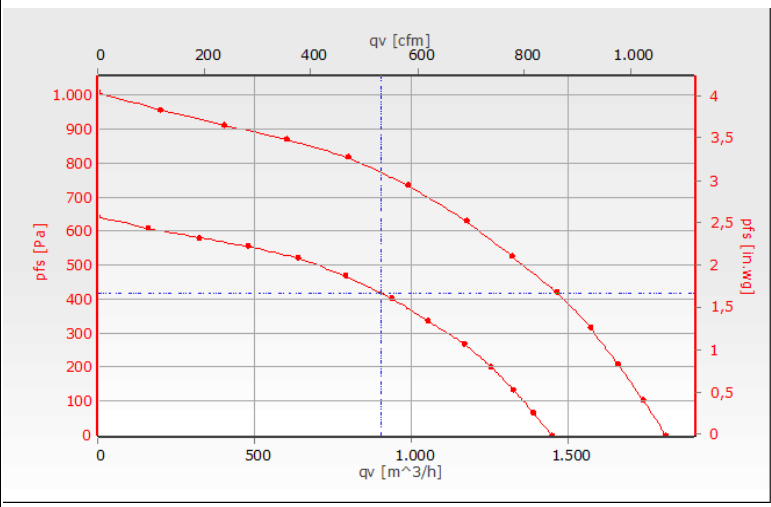Airflow	900 m³/h	Fan Model	EBM Papst-R3G250RO0671		Quantity	1	Section Weight	58 kg																																													
Internal Static Pressure	269 Pa	Motor P./Pha./Volt./Freq.	0,39 kW/1P/230V/50-60Hz	Isolator	Isolator Count	Backup Fan	Backup Motor																																														
External Static Pressure	150 Pa																																																				
Total Static Pressure	419 Pa																																																				
Total Pressure	449 Pa								System Effect	29 Pa																																											
Total / Static Efficiency	53,69 / 50,06 %																																																				
Shaft Power / Absorbed Power	0,21 / 0,23 kW								Absorbed Pow.With VFD	0,23 kW																																											
Fan Speed	2712 rpm (Max.3400 rpm)																																																				
	Air Density	1,2000 kg/m³																																																			
Specific Fan Power (SFPe int)	0,44 kW/(m³/s)	<table border="1" style="width: 100%; text-align: center;"> <thead> <tr> <th colspan="11">Sound Power Level (dB)</th> </tr> <tr> <th>Hz</th> <th>63</th> <th>125</th> <th>250</th> <th>500</th> <th>1000</th> <th>2000</th> <th>4000</th> <th>8000</th> <th>LwA-tot</th> <th></th> </tr> </thead> <tbody> <tr> <td>SPLm - Outlet Side</td> <td>69,6</td> <td>67,0</td> <td>69,1</td> <td>72,2</td> <td>73,2</td> <td>68,2</td> <td>64,7</td> <td>57,5</td> <td>76,3</td> <td>dBA</td> </tr> <tr> <td>SPLa - Inlet Side</td> <td>64,6</td> <td>62,0</td> <td>64,1</td> <td>67,2</td> <td>68,2</td> <td>63,2</td> <td>59,7</td> <td>52,5</td> <td>71,3</td> <td>dBA</td> </tr> </tbody> </table>								Sound Power Level (dB)											Hz	63	125	250	500	1000	2000	4000	8000	LwA-tot		SPLm - Outlet Side	69,6	67,0	69,1	72,2	73,2	68,2	64,7	57,5	76,3	dBA	SPLa - Inlet Side	64,6	62,0	64,1	67,2	68,2	63,2	59,7	52,5	71,3	dBA
Sound Power Level (dB)																																																					
Hz	63	125	250	500	1000	2000	4000	8000	LwA-tot																																												
SPLm - Outlet Side	69,6	67,0	69,1	72,2	73,2	68,2	64,7	57,5	76,3	dBA																																											
SPLa - Inlet Side	64,6	62,0	64,1	67,2	68,2	63,2	59,7	52,5	71,3	dBA																																											
Electrical Current	0,99 A (Max.1,84 A)	<p>* The fan system effect is taken into account in the fan performance</p> <p>* The fan calculated for wet conditions</p> <p>* Sfp is calculated based on clean filter & dry coil conditions</p>																																																			

ACCESSORIES (M5)

Lightening, Observation Glass	
-------------------------------	---